


DEPARTMENT OF  
PUBLIC UTILITIES  
LOS ALAMOS COUNTY  
LOS ALAMOS, NEW MEXICO



UTILITY CONSTRUCTION STANDARDS - WATER  
1" & 2" POTABLE WATER  
AIR RELEASE & VACUUM VALVE

SECTION  
6000  
6012

No. \_\_\_\_\_  
DATE: \_\_\_\_\_  
REVISION: \_\_\_\_\_  
APPROVED BY: \_\_\_\_\_  
DATE: OCTOBER 2007

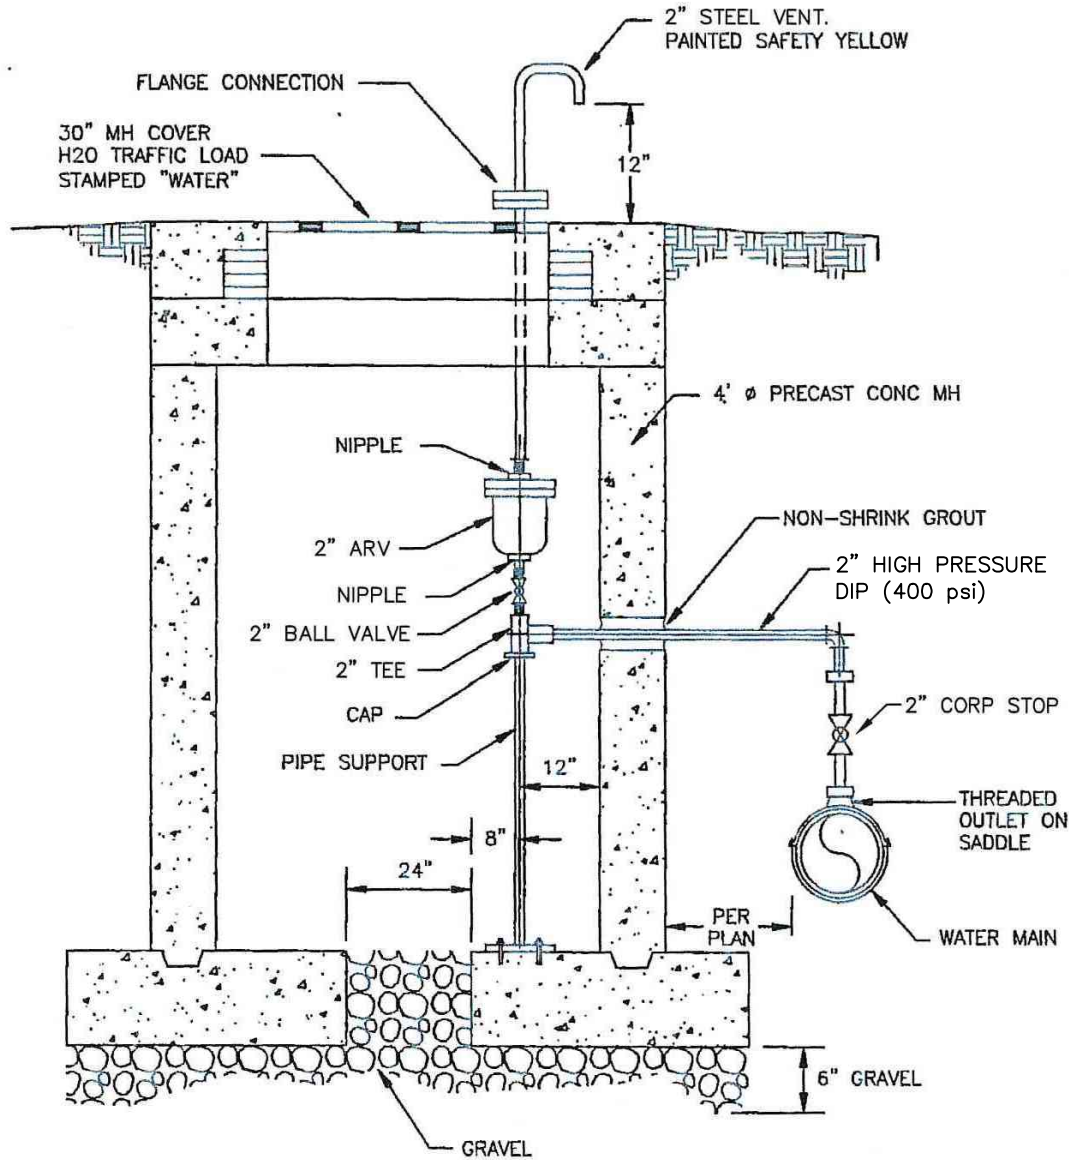

NOTES:

1. INSTALL 1" ARV ON 8" TO 12" WATER LINES.
2. INSTALL 2" ARV ON 14" AND LARGER WATER LINES.
3. ARV, SADDLE, BRASS FITTINGS AND VALVE PER LOS ALAMOS COUNTY UTILITIES CONSTRUCTION STANDARDS SPECIFICATION 601 WATER SYSTEMS.
4. MANHOLE PER LOS ALAMOS COUNTY UTILITIES CONSTRUCTION STANDARDS SPECIFICATION 502 MANHOLES.
5. VAL-MATIC COMBINATION AIR VALVE-SINGLE BODY MODEL VM-201C-M, OR EQUAL.
6. FOR THIS PROJECT. ALL PIPING AND VALVES SHALL MEET 400 psi CAPABILITY.